



EXHIBIT I
TAHOE CEDARS
PRIVATE WATER SERVICE RELOCATION

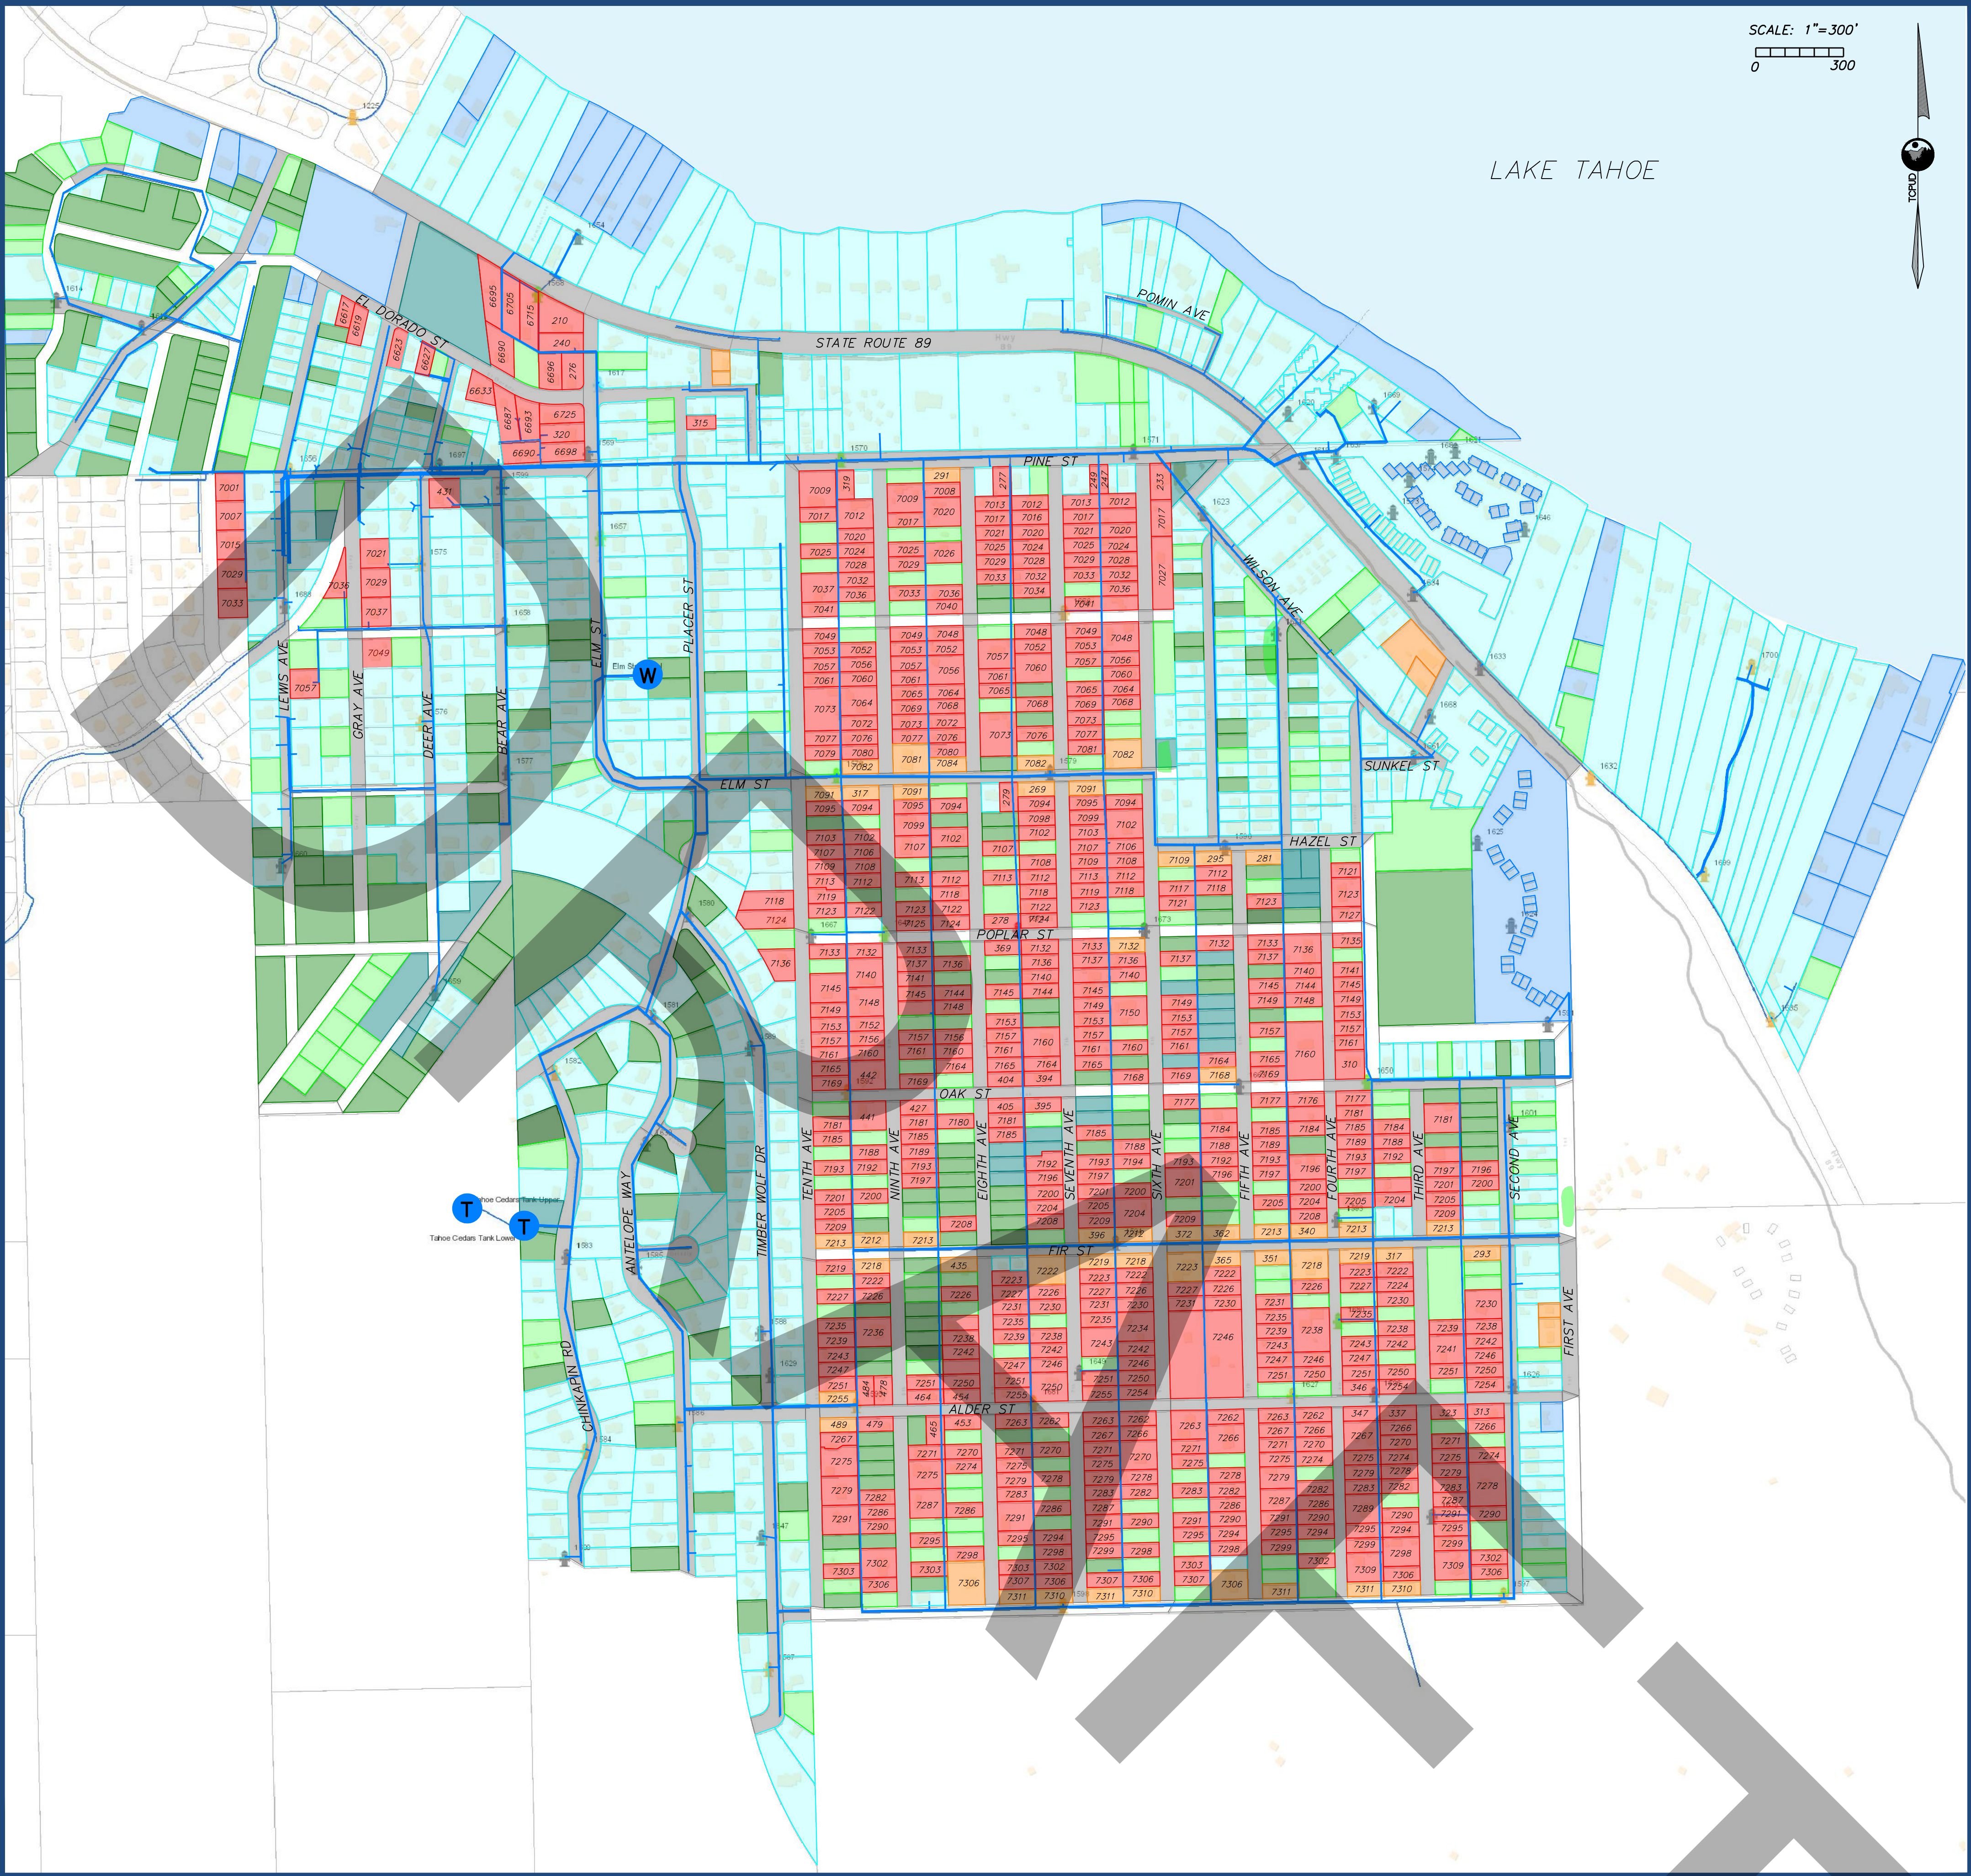

LOT TOTALS	
583	RECONNECTION REQUIRED
50	RECONNECTION MAY BE REQUIRED
602	SERVICE AT FRONT OF LOT – NO RECONNECTION
93	UNKNOWN SERVICE – NO RECONNECTION
221	NO EXISTING SERVICE – PRIVATE
180	NO EXISTING SERVICE – CTC
6	NO EXISTING SERVICE– USFS
30	NO EXISTING SERVICE – OTHER PUBLIC

- LEGEND
- SERVICE RECONNECTION REQUIRED
 - SERVICE RECONNECTION MAY BE REQUIRED
 - SERVICE AT FRONT OF LOT – NO RECONNECTION REQUIRED
 - UNKNOWN SERVICE–NO RECONNECTION REQUIRED
 - NO EXISTING SERVICE–PRIVATE
 - NO EXISTING SERVICE–CTC
 - NO EXISTING SERVICE–USFS
 - NO EXISTING SERVICE–OTHER PUBLIC
 - EXISTING WATER MAIN
 - WATER TANK
 - WELL

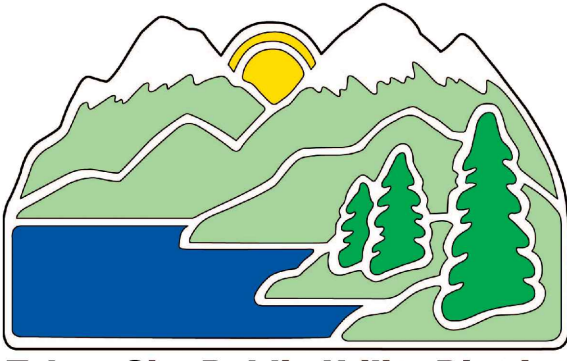

Tahoe City Public Utility District
JUNE 4, 2024

DISCLAIMER:
THE DRAWING WAS CREATED FROM DATA SUPPLIED FROM THE PREVIOUS WATER SERVICE PROVIDER WITH LIMITED FIELD VERIFICATION. THE TCPUD MAKES NO CLAIMS CONCERNING THE ACCURACY OF THE DATA. EACH PROPERTY WILL REQUIRE FIELD VERIFICATION TO ENSURE LOCATION OF SERVICE CONNECTIONS.